

---

B.F.H.C. KADAMPAZHIPPURAM

NO : 73/2025

DATE 24-02-2025




## SANITARY CERTIFICATE

THIS IS TO CERTIFY THAT I HAVE INSPECTED THE SCHOOL BUILDING AND PREMISES OF SREEKRISHNAPURAM CENTRAL SCHOOL -,KADAMPAZHIPPURAM P.O. PALAKKAD DISTRICT ON 17-01-2025 AND FOUND THE ROOMS ARE PROPERLY VENTILATED AND LIGHTED . URINALS AND LATRINE ARRANGEMENTS ARE ADEQUATE AND SATISFACTORY.

THE SUPPLY OF DRINKING WATER IS GOOD AND WHOLSOME IN ALL RESPECT THE SANITATION IS GOOD ACCORDING TO THE PROVISIONS OF KERALA PUBLIC HEALTH ACT—2023.

THIS CERTIFICATE IS ISSUED TO PRODUCE BEFORE THE AEO..CHERPULASSERY



  
M. RAJANI  
Health Inspector  
BFHC, Katampazhipuram

# KERALA WATER AUTHORITY



Report No:37312		Report Issue Date : 04-01-2025
Customer Name & Address		Date of Receipt
DAIS K. MATHEW H .M Sreekrishnapuram Central School Kadampazhipuram 678633		30-12-2024
		Purpose of Test
		Customer
		Sample Name
		Drinking Water
		Sample Condition
		Good
		Sample Code
		MNRKD/37312
		Source of Sample
		Open well
		Purpose of Test
		Domestic
		Sample Quantity
		2.Litre
		Test performing date
		From31/12/2024 to 03/01/2025

Sl.No	Characteristics		Test Method	Acceptable Limit as per IS 10500-2012	Result
1	Colour	Hazen	IS 3025 (Part 4)-2021 platinum cobalt visual comparison	5.0000	5
2	Odour		IS 3025 (Part 5)- 2018	Agreeable	Agreeable
3	Turbidity	(NTU)	IS 3025 (Part 10) 2023 Nephelometric method	1.00	0.13
4	pH ay 25° C	-	IS 3025 (Part11)-2022 Electrometric method	6.5 to 8.5	6.17
5	Alkalinity	(mg/litre)	IS 3025 (Part 23)-2019 Indicator method	200.00	4.00
6	Total Dissolved Solids (TDS)	(mg/litre)	IS 3025 (Part 16)-2023 Gravimetric method	500.00	10.00
7	Total Hardness (as CaCO3)	(mg/litre)	IS 3025 (Part21)-2019 EDTA method	200.00	3.99
8	Calcium (as Ca)	(mg/litre)	IS 3025 (Part 40)-2019 EDTA method	75.00	0.79
9	Magnesium (as Mg)	(mg/litre)	APHA 23 rd Edition:3500 method B(By calculation 2017)	30.00	0.48
10	Chloride (as Cl)	(mg/litre)	IS 3025 (Part 32)-2019 Argentometric method	250.00	4.92

Remarks :-


- NB:- 1.The result stated above related only to the sample(s) submitted for testing .  
2.The samples retain for 7 days from the date of issue.  
3. The test certificate shall not be reproduced except in full without the written approval of the Laboratory.

Kanya krishnan .c  
Analysed by *[Signature]*

*[Signature]*  
Authorized by

KWA/QCSDL/MNRKD /12-2021	Issue : 1	Issue Date :	01-12-2021
Ref No:00	Rev,Date:00	Page 1 of 1	

TECHNICAL MANAGER  
QUALITY CONTROL SUB DISTRICT LAB  
KERALA WATER AUTHORITY

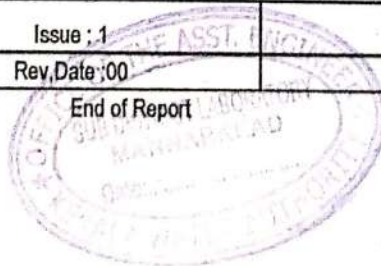

DY. QUALITY MANAGER  
KERALA WATER AUTHORITY  
QCCL PALAKKAD-678 001

# KERALA WATER AUTHORITY



## WATER TEST REPORT

Report No:37312		Report Issue Date : 04-01-2025			
Customer Name & Address		Date of Receipt	30-12-2024		
DAIS K. MATHEW H .M Sreekrishnapuram Centrial School Kadampazhipuram 678633		Sampling Done by	Customer		
		Sample Name	Drinking Water		
		Sample Condition	Good		
		Sample Code	MNRKD/37312		
		Source of Sample	Open well		
		Purpose of Test	Domestic		
		Sample Quantity	2.Litre		
		Test performing date	From 31/12/2024 to 03/01/2025		
Sl.No	Characteristics	Unit	Test Method	Acceptable Limit as per IS 10500-2012	Result
11	Acidity	(mg/litre)	IS 3025(Part 22- 2019)	-	18
12	Electrical Conductivity at 25°C	(micromhos/cm)	IS 3025(Part 22- 2019)	-	19.31
13	Sulphate ( as SO4)	(mg/litre)	IS 3025(Part 24 / sec 1)2022	200.00	2.26
14	Fluoride (as F)	(mg/litre)	IS 3025(Part 60)-2008(Reaffirmed 2019)	1.00	0.01
15	Iron (as Fe)	(mg/litre)	IS 3025(Part 53- 2003)(Reaffirmed 2019)	1.00	0.01
16	Nitrate (as NO3)	(mg/litre)	APHA 4500-NO <sub>3</sub> B 2017	45.00	0.01

Remarks :-


- NB:- 1.The result stated above related only to the sample(s) submitted for testing .  
2.The samples retain for 7 days from the date of issue.  
3. The test certificate shall not be reproduced except in full without the written approval of the Laboratory.

Analysed by *Kanya krishnan c*

Authorized by *[Signature]*

KWA/QCSDL/MNRKD /12-2021	Issue : 1	Issue Date :	01-12-2021
Ref No: 0	Rev,Date :00	Page 1 of 2	

TECHNICAL MANAGER  
QUALITY CONTROL SUB DISTRICT LAB  
KERALA WATER AUTHORITY

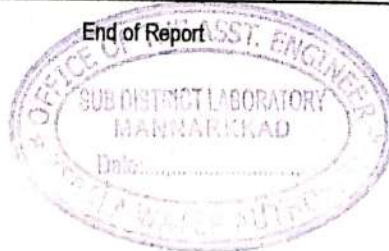

DY. QUALITY MANAGER  
KERALA WATER AUTHORITY  
QCCL PALAKKAD-678 001

# KERALA WATER AUTHORITY

## WATER TEST REPORT

Report No:37312		Report Issue Date : 04-01-2025			
Customer Name & Address		Date of Receipt	30-12-2024		
DAIS K. MATHEW H .M Sreekrishnapuram Central School Kadampazhipuram 678633		Sampling Done by	Customer		
		Sample Name	Drinking Water		
		Sample Condition	Good		
		Sample Code	MNRKD/37312		
		Source of Sample	Open well		
		Purpose of Test	Domestic		
		Sample Quantity	2.Litre		
		Test performing date	From 31/12/2024 to 03/01/2025		
		Sl.No	Characteristics	Parameters	Test Method
1	Coliform	Total coliform in 100 ml	IS 15185:2016 ISO 93081:2014 Membrane Filter Technique	Shall not be detected/100 ml	Not Detected
2	E.coli	Total E-coli in 100 ml	IS 15185:2016 ISO 93081:2014 Membrane Filter Technique	Shall not be detected/100 ml	Not Detected

Remarks :- Coliform Bacteria Detected

NB:- 1.The result stated above related only to the sample(s) submitted for testing .

2.The samples retain for 7 days from the date of issue.

3. The test certificate shall not be reproduced except in full without the written approval of the Laboratory.


Analysed by

*Karthika*  
*Karthika*

*Karthika*  
*Karthika*  
Authorized by

KWA/QCSDL/MNRKD/12-2021	Issue : 1			Issue Date : 01/12/2021
Ref No:Nil	Rev,Date :Nil		Page 2 of 2	

BACTERIOLOGIST  
 QUALITY CONTROL SUB DISTRICT LAB  
 KERALA WATER AUTHORITY

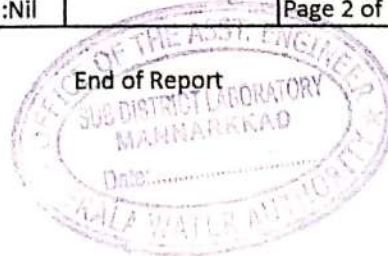

BACTERIOLOGIST  
 QUALITY CONTROL SUB DISTRICT LAB  
 KERALA WATER AUTHORITY